


FOR HONEYWELL CONTROL, HONEYWELL GAS VALVE

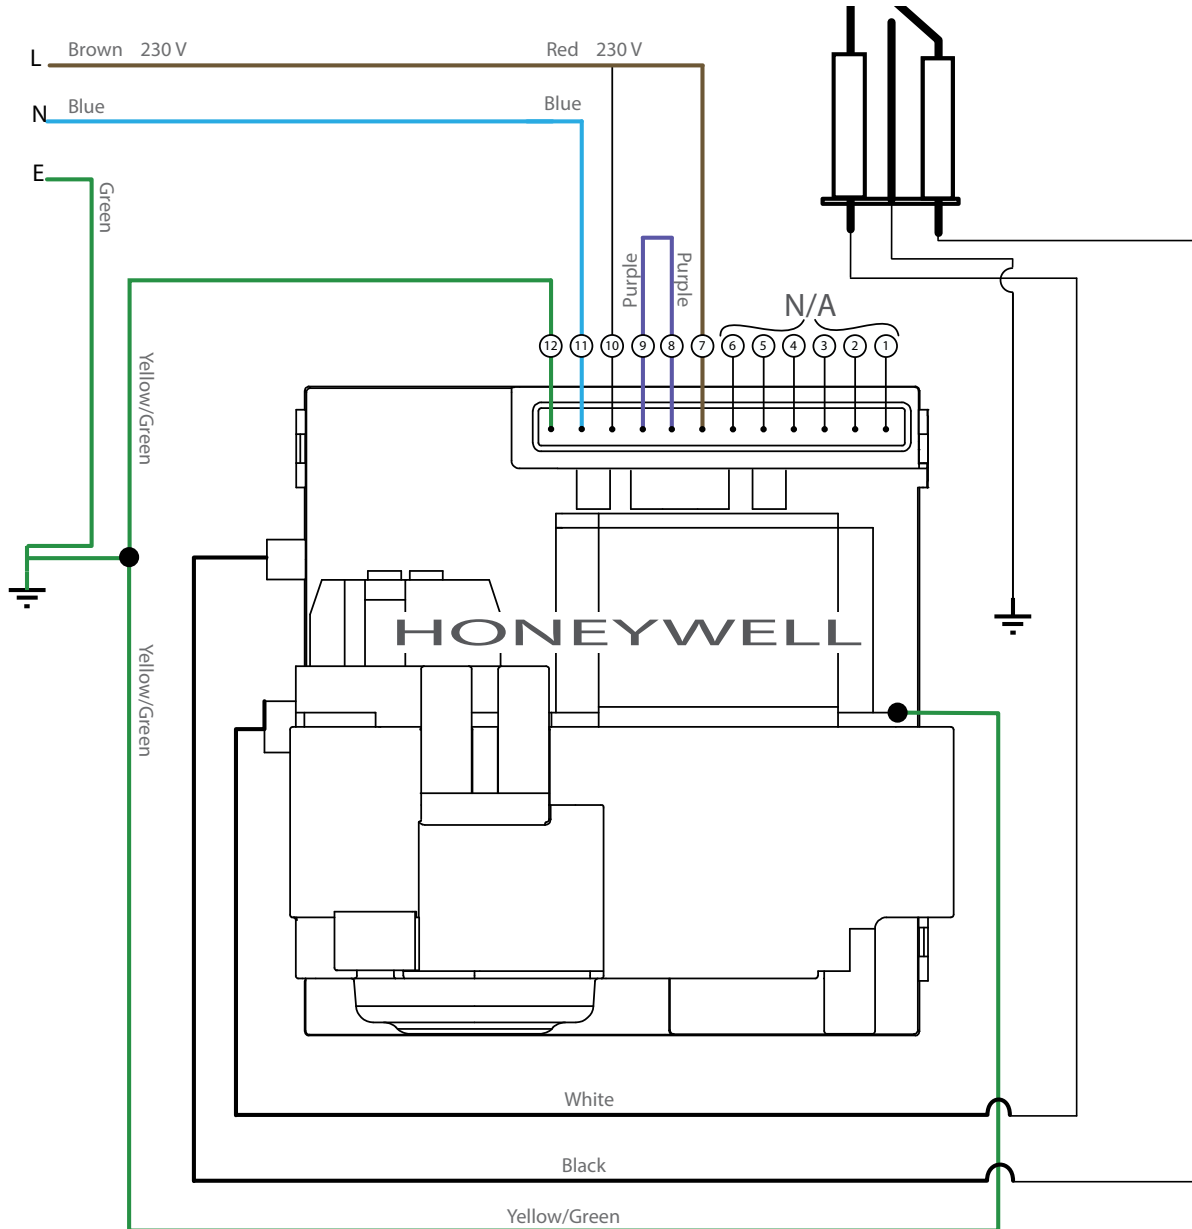

NOTE:

If any of the original wire as supplied with the heater must be replaced, it must be replaced with 18AWG, 90°C type UL approved wire or its equivalent. If Transformer must be replaced, a UL approved model of similar type must be used.

AUS Head Office

10 Phiney Place, Ingleburn
Sydney, NSW 2565 Australia
T: +61 2 9426 5222

W: bromic.com/heating-au
E: info@bromic.com.au

USA Head Office

18 Technology Drive,
Suite 121 Irvine, CA 92618
T: 1800 301 1293

W: bromic.com/heating
E: info@bromic.com

Europe Office

Weinuallee 19
02763 Zittau Germany
T: +49 358 3518 9885

W: bromic.com/heating-de
E: info@bromic.de